



DETAIL 1

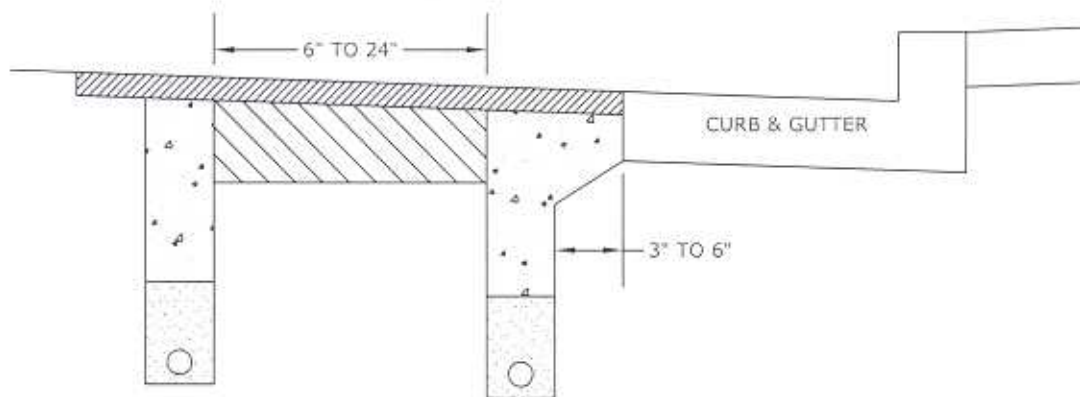

DETAIL 2

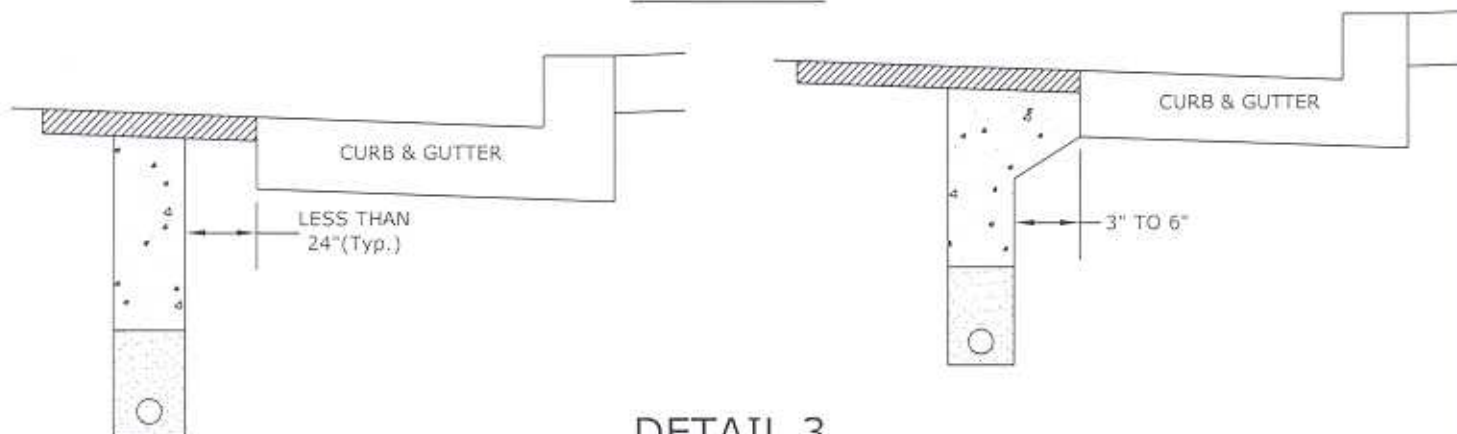

DETAIL 3

NOTES:

1. The top 2" (min.) of the concrete backfill shall be grinded down prior to placing permanent pavement surface.
2. For trenches less than 6" apart, remove full pavement section and replace with concrete backfill.
3. Temporary surfacing shall be inspected daily by the contractor and repaired within 48 hours with 1" uplift or settlement. Temporary surfacing shall not be used for more than two weeks and shall be removed prior to final pavement placement.
4. In the case of identified bicycle lanes the total patch shall extend to 6' from the lip of gutter.

NOT TO SCALE

CITY OF MILPITAS, ENGINEERING DIVISION				STANDARD DRAWING	
REVISION	DATE	DESIGNED:	ROCKWHEEL STREET TRENCH		
1		DRAWN: JV			
		CHECKED: MK			
		1	APPROVED BY: <i>[Signature]</i>	ORIGINAL DATE: 8/7/95	
			PUBLIC WORKS DIRECTOR / CITY ENGINEER	SHEET 1 OF 1	
			DATE: 11/9/00		